




Elevation View

#6 Cu for 100 Amp Service  
 #4 Cu for 200 Amp Service

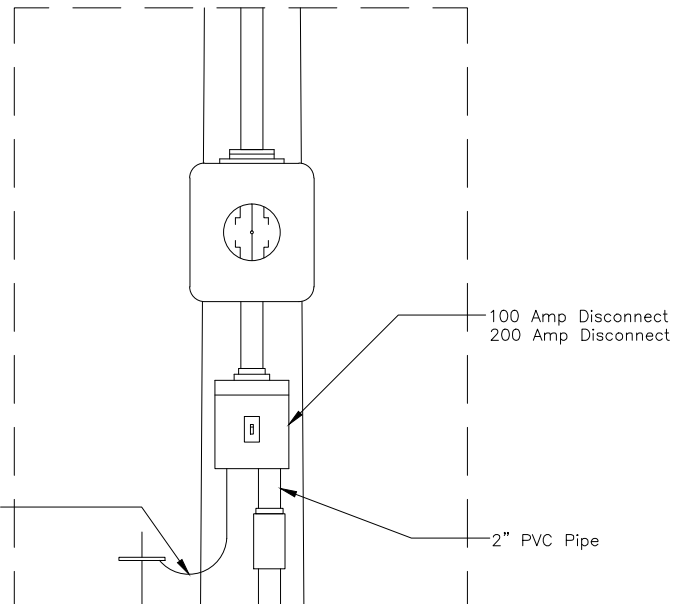

100 Amp Disconnect  
 200 Amp Disconnect

2" PVC Pipe

Coop will furnish Overhead Wire  
 and make connections to  
 Customers Entrance Wire

4"x6"x16'  
 min.

100 Amp Service - Three #2 Copper wires or Three #2 Aluminum wires  
 200 Amp Service - Three #3/0 Copper wires or Three #4/0 Aluminum wires

16' Min

Drip Loop


Entrance Cable

16'

Ground Line

4'

50' Max.

A	 Holmes-Wayne Electric Cooperative, Inc. <small>A Touchstone Energy Cooperative</small>	DWG NAME: Trailer Service Hookup Entrance Cable
	SCALE: NONE	DATE: 7-28-2008
		SHEET: 1 OF 1